



For expansion, please see
"Expansion joint list"
Doc No. 148120/00 620-7998


Detail:
soft fabric expansion joint
with insulation

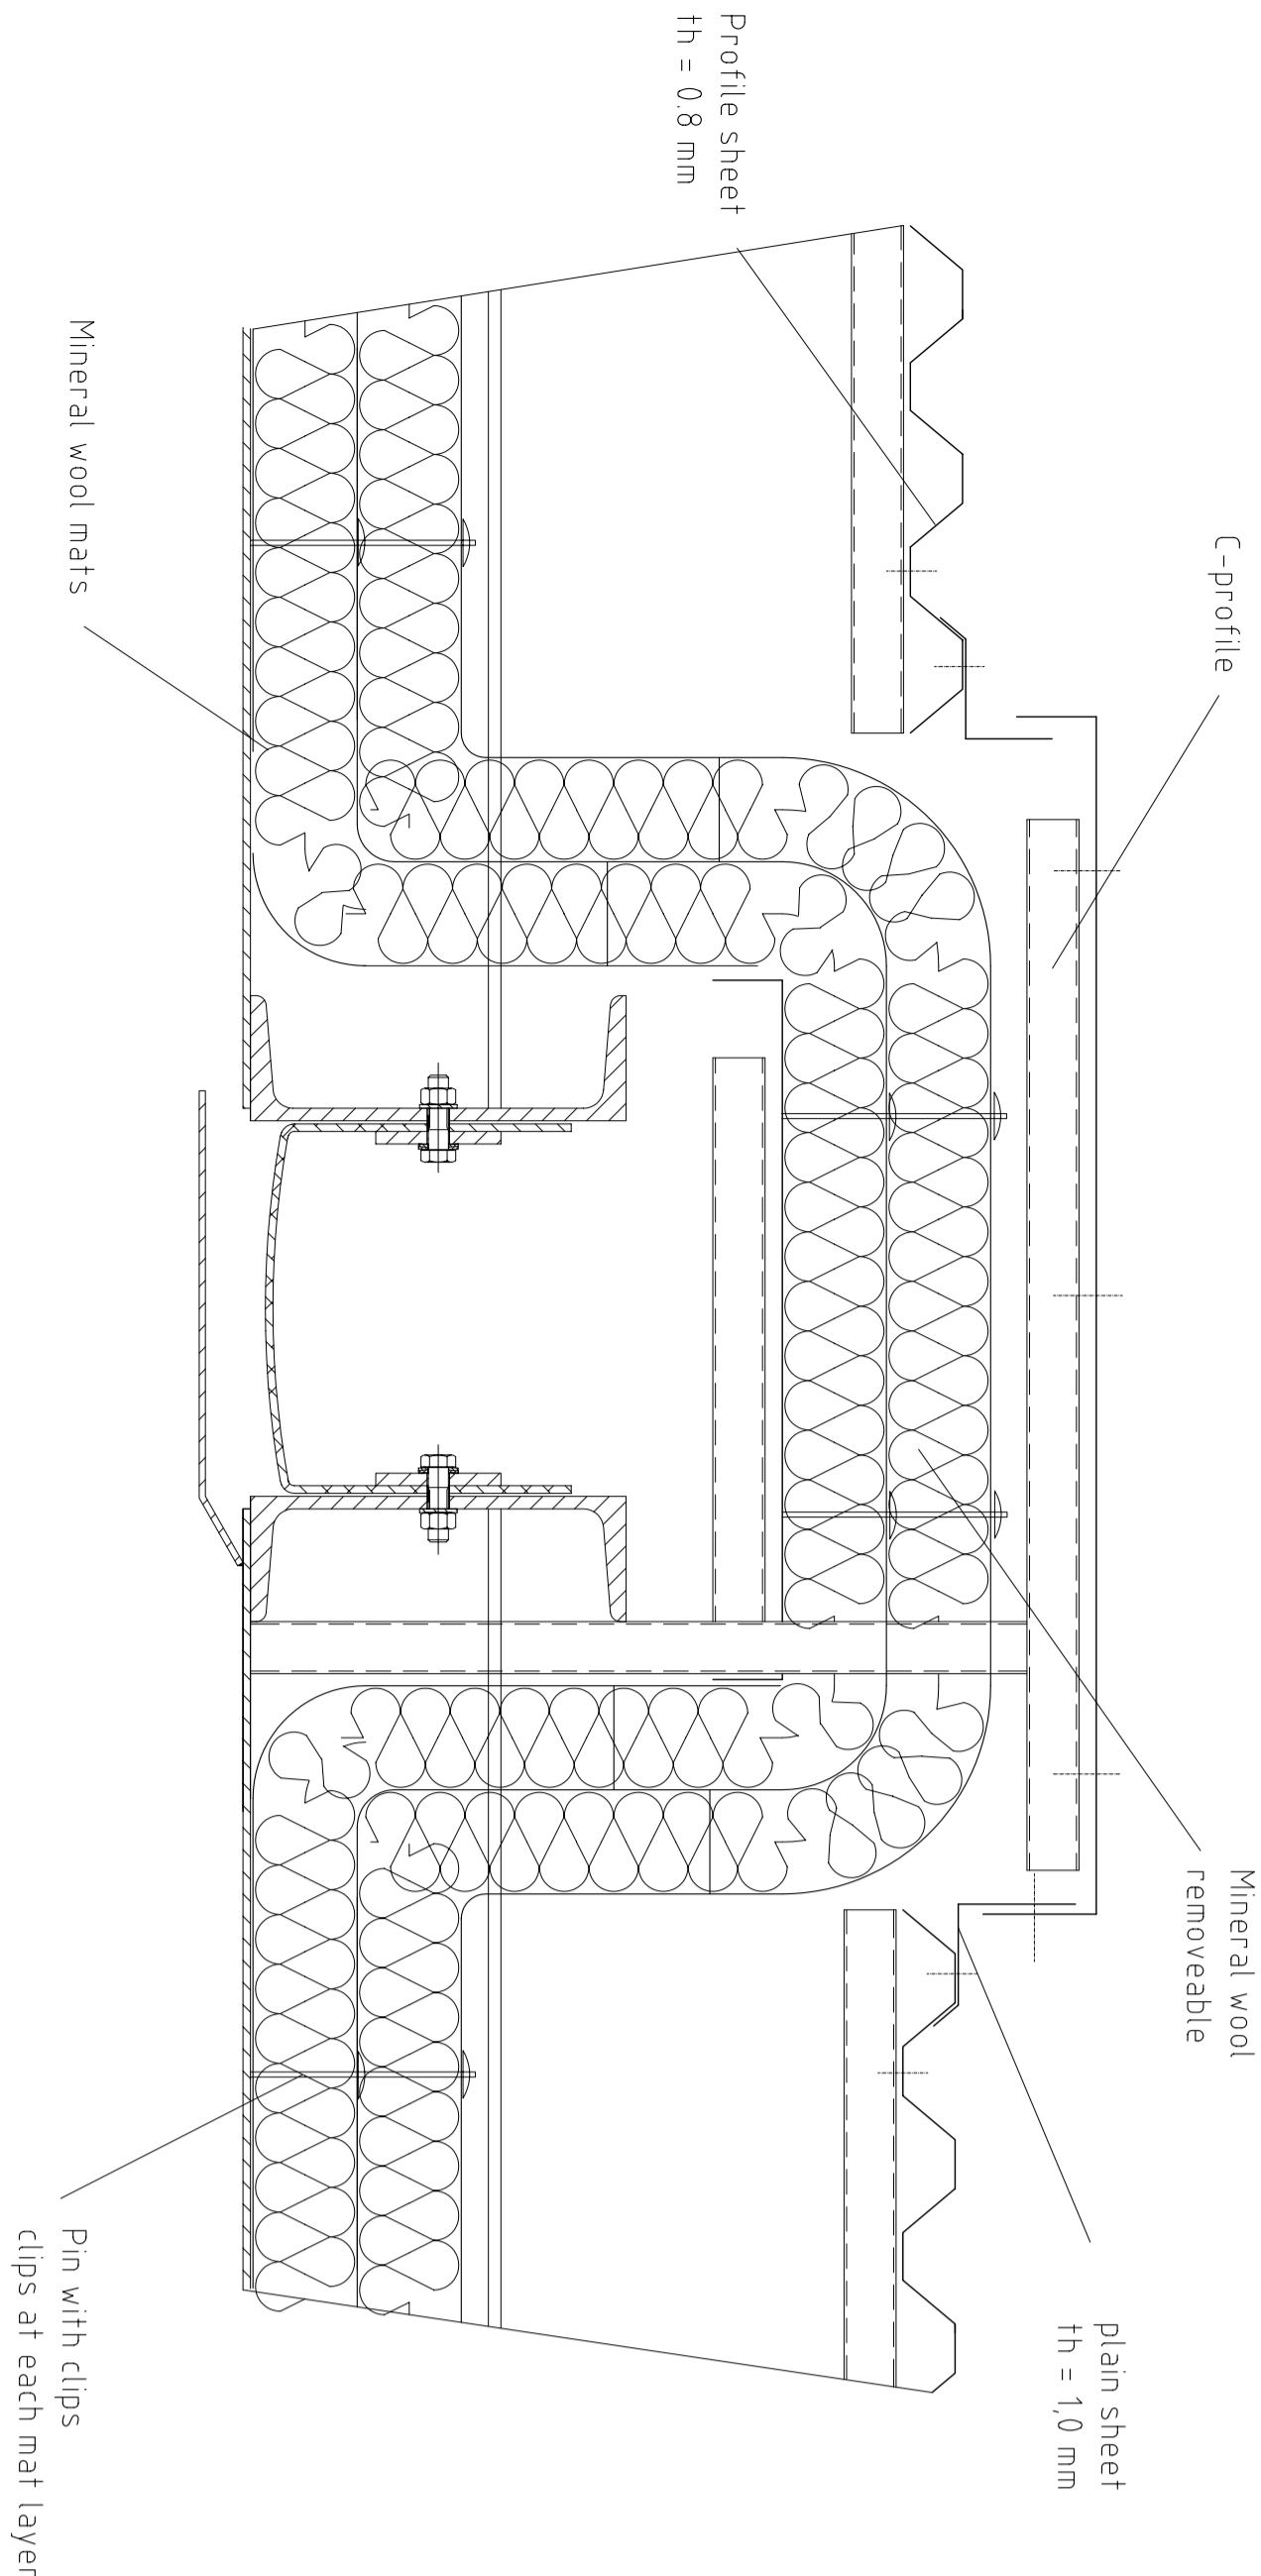

Detail:
soft fabric expansion joint
with personnel protection

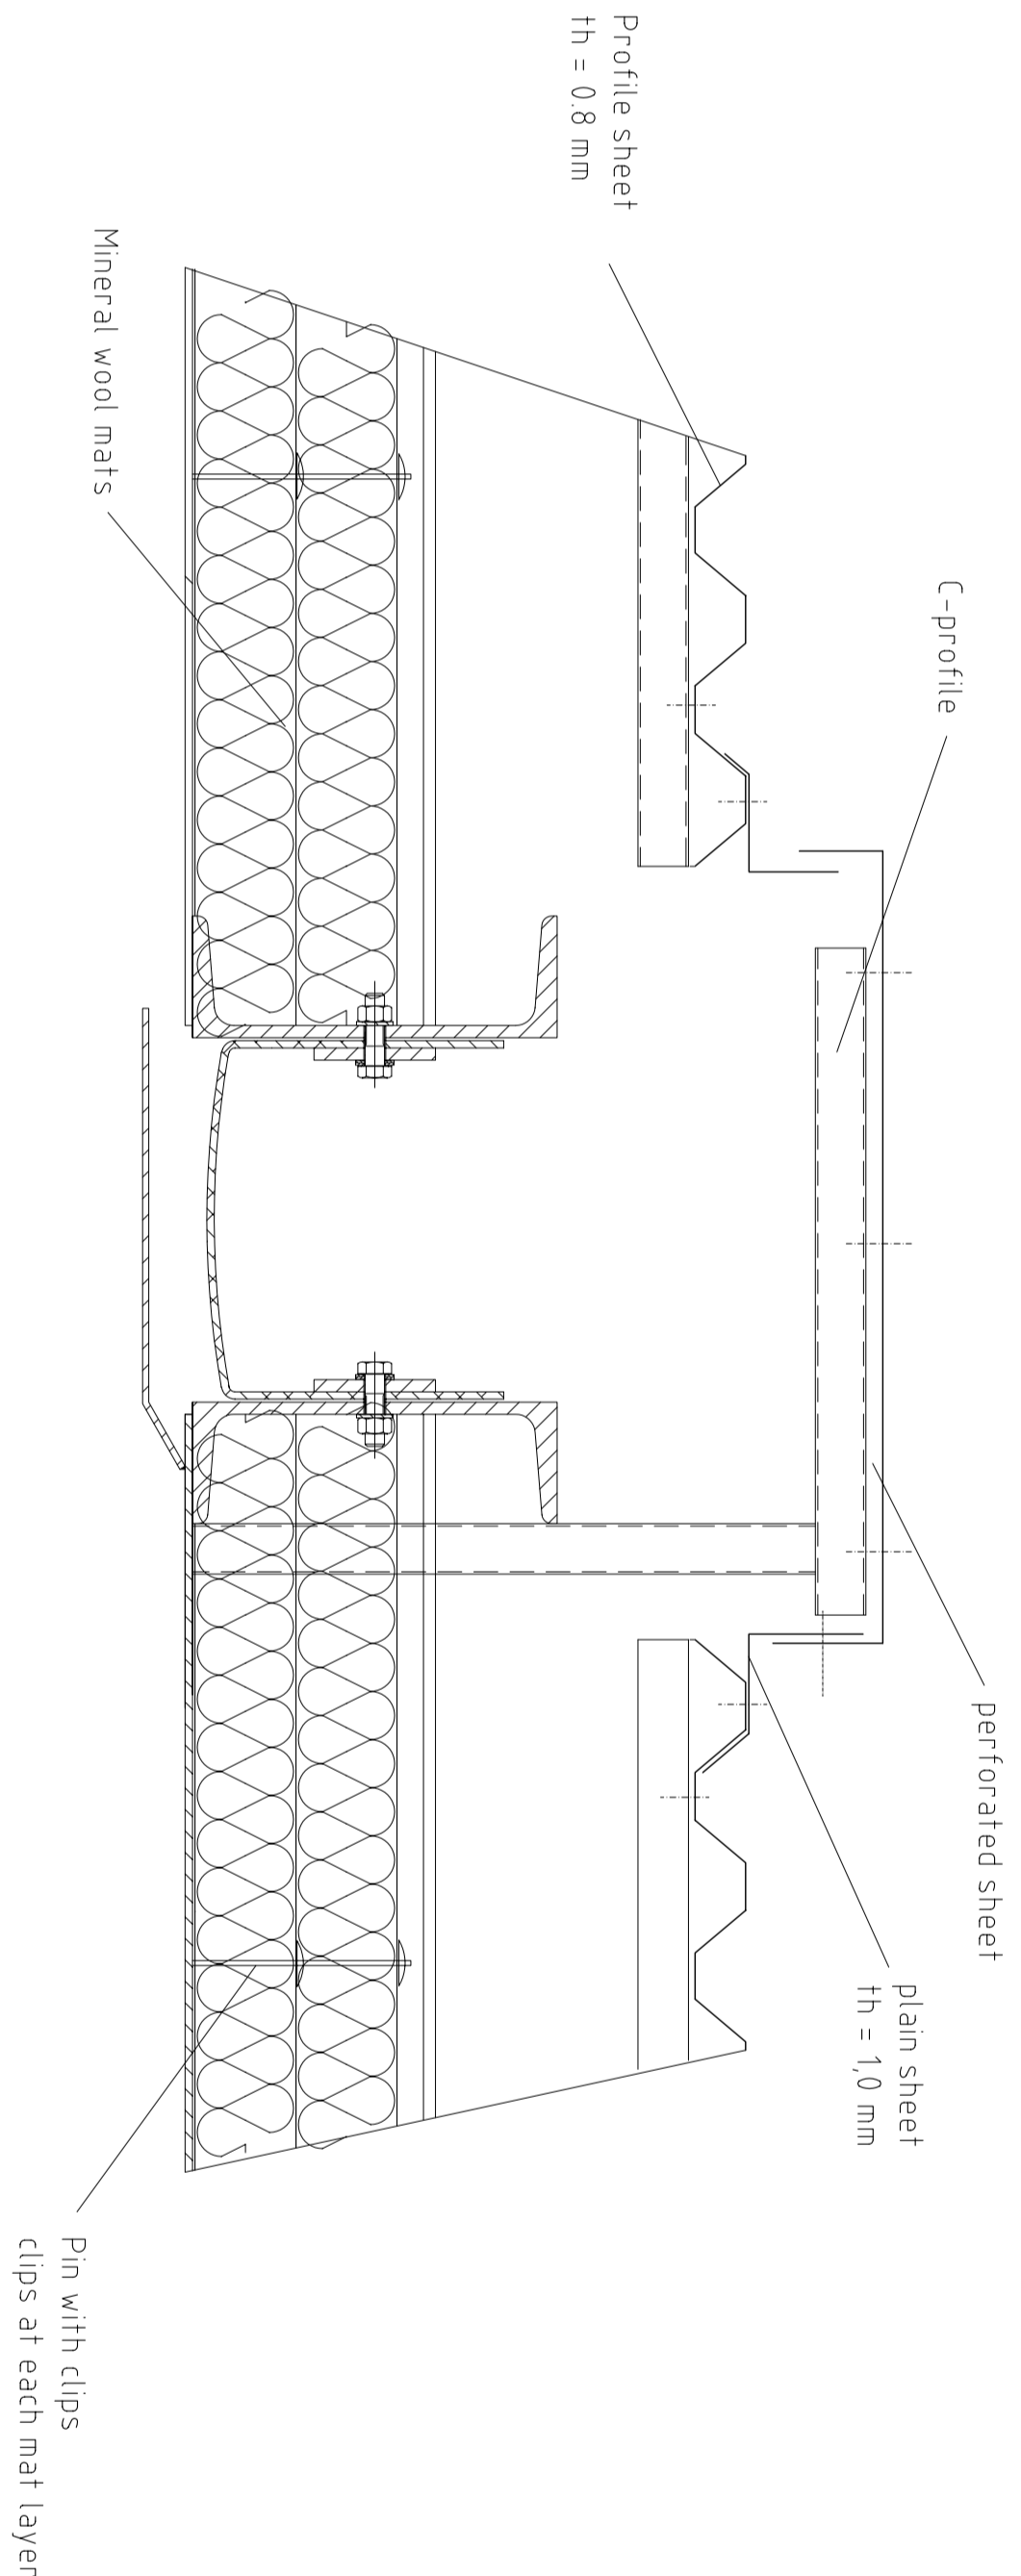


Detail:
Damper

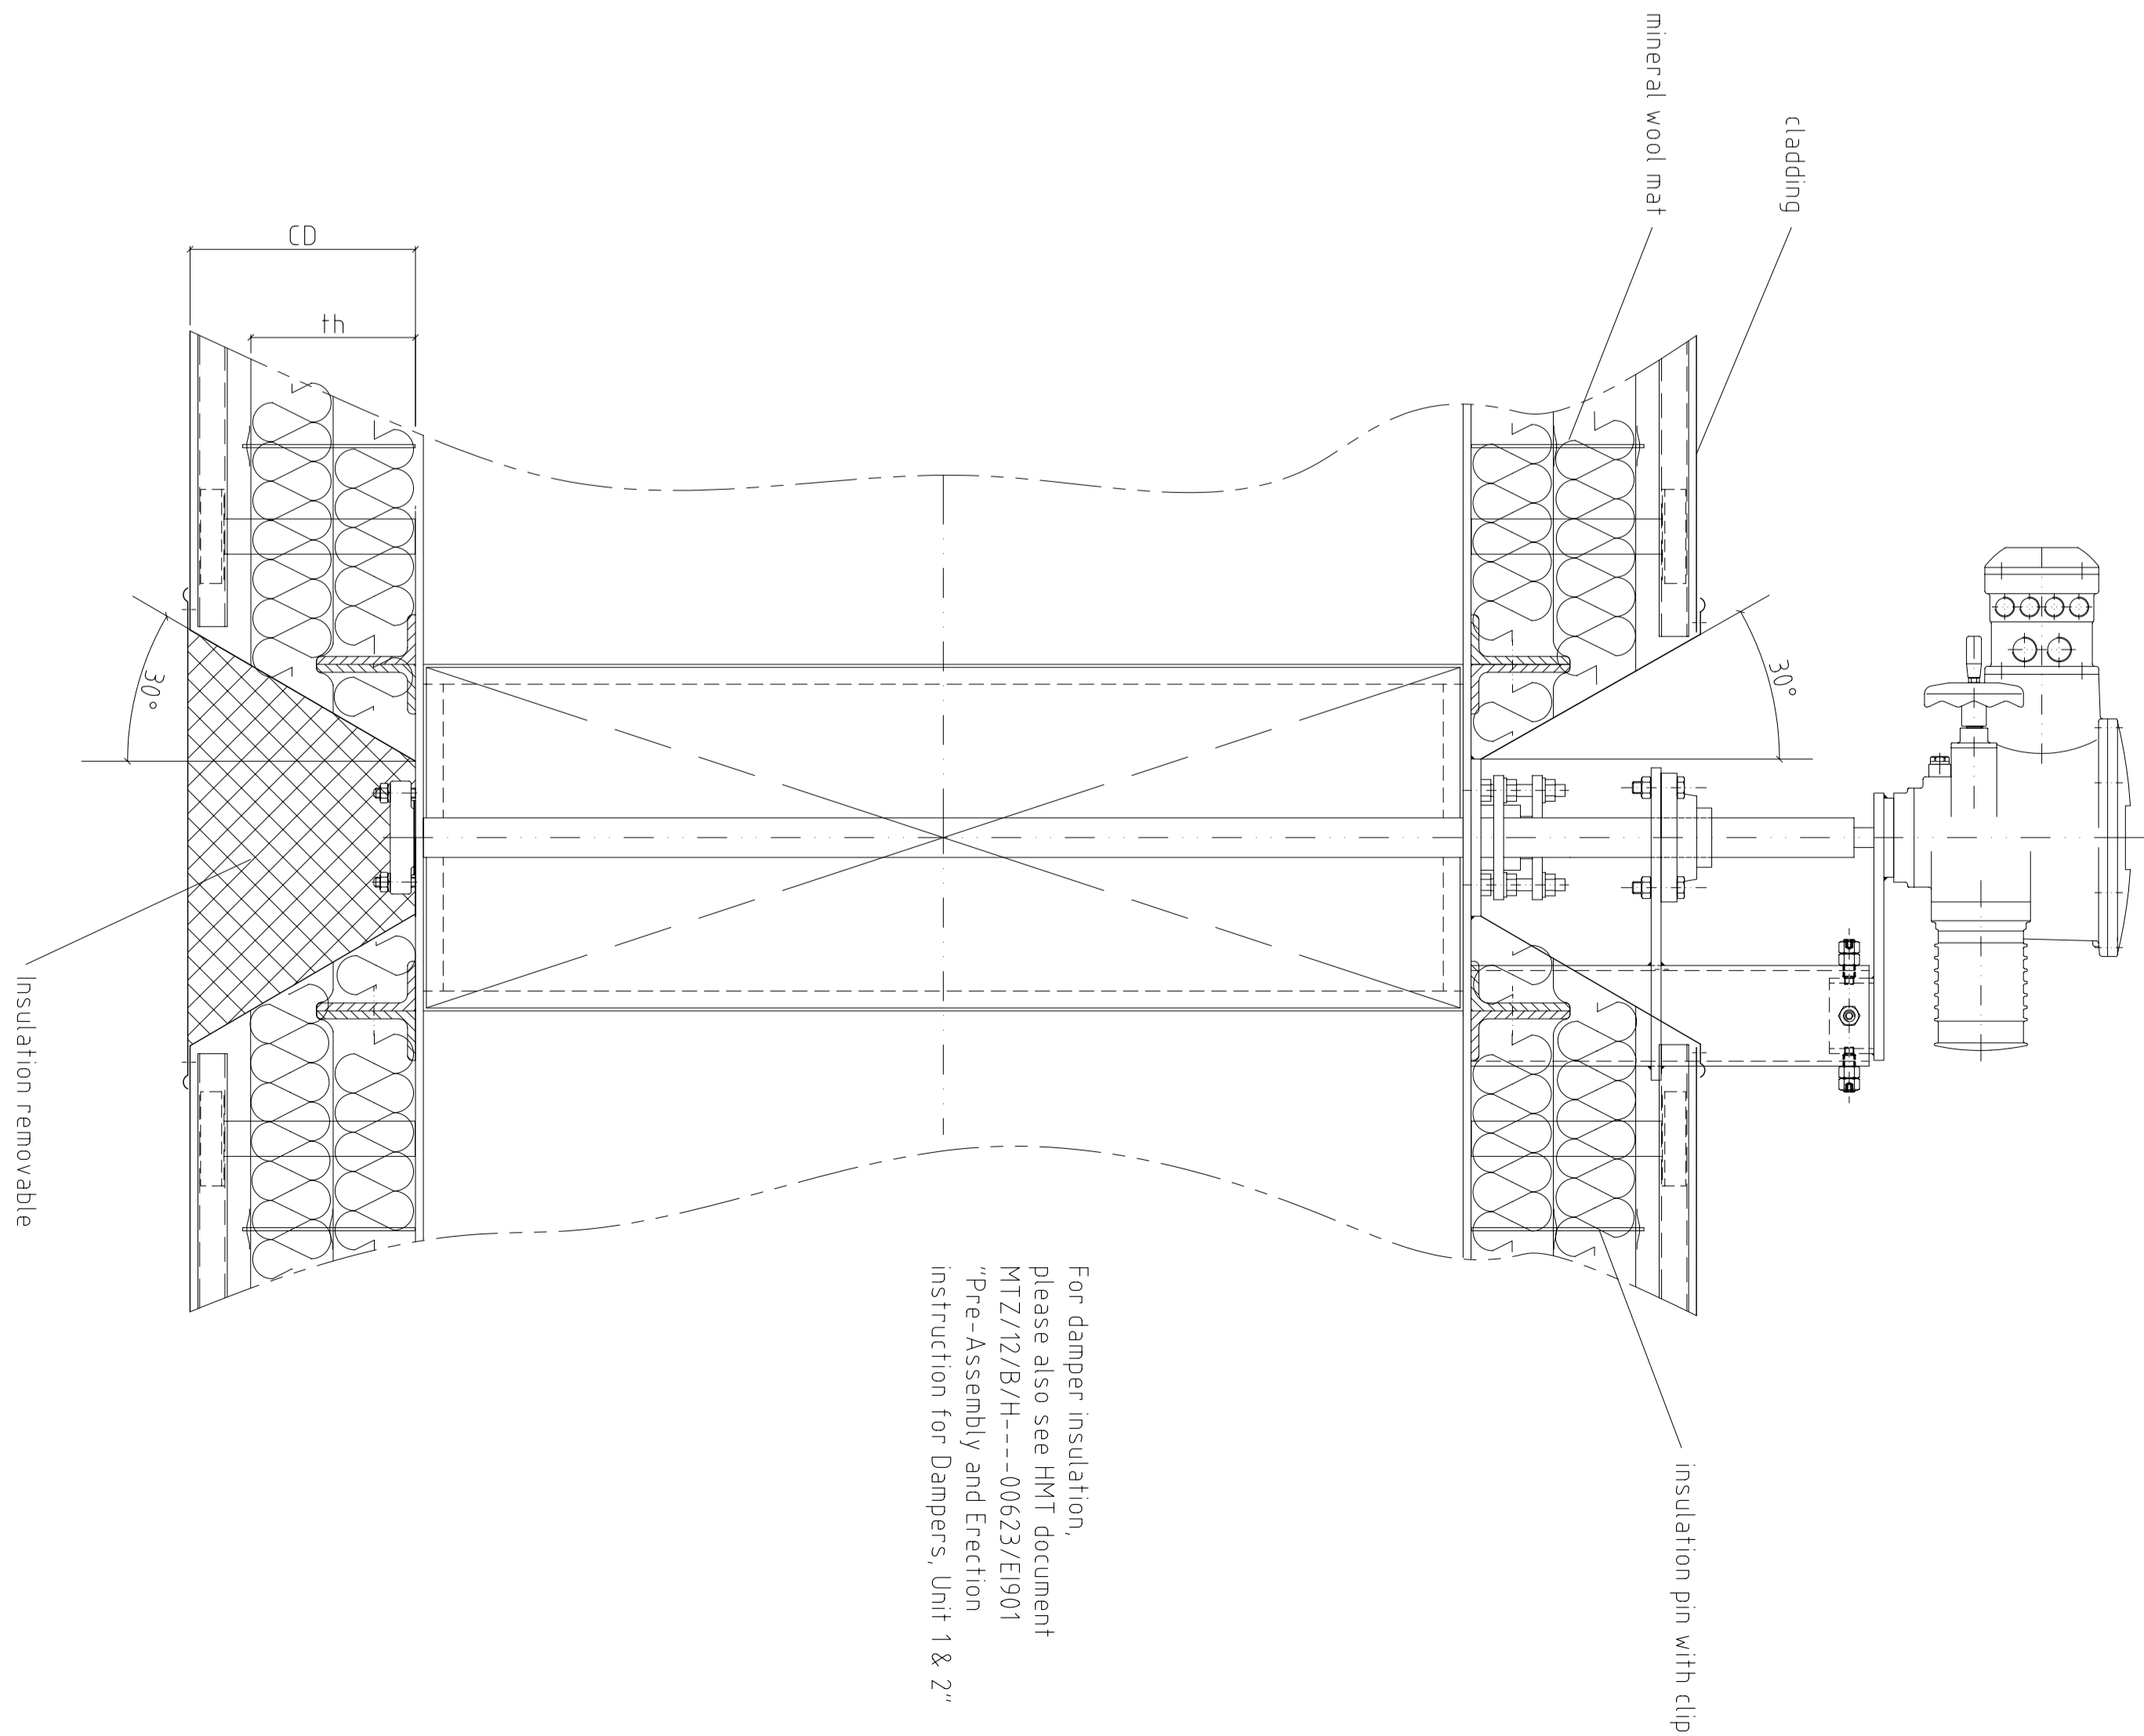


For damper insulation,
please also see HMT document
MTZ/12/18/H/---00623/E901
"Pre-Assembly and Erection
Instruction for Dampers, Unit 1 & 2"


Detail:
metal expansion joint
(with guideway)

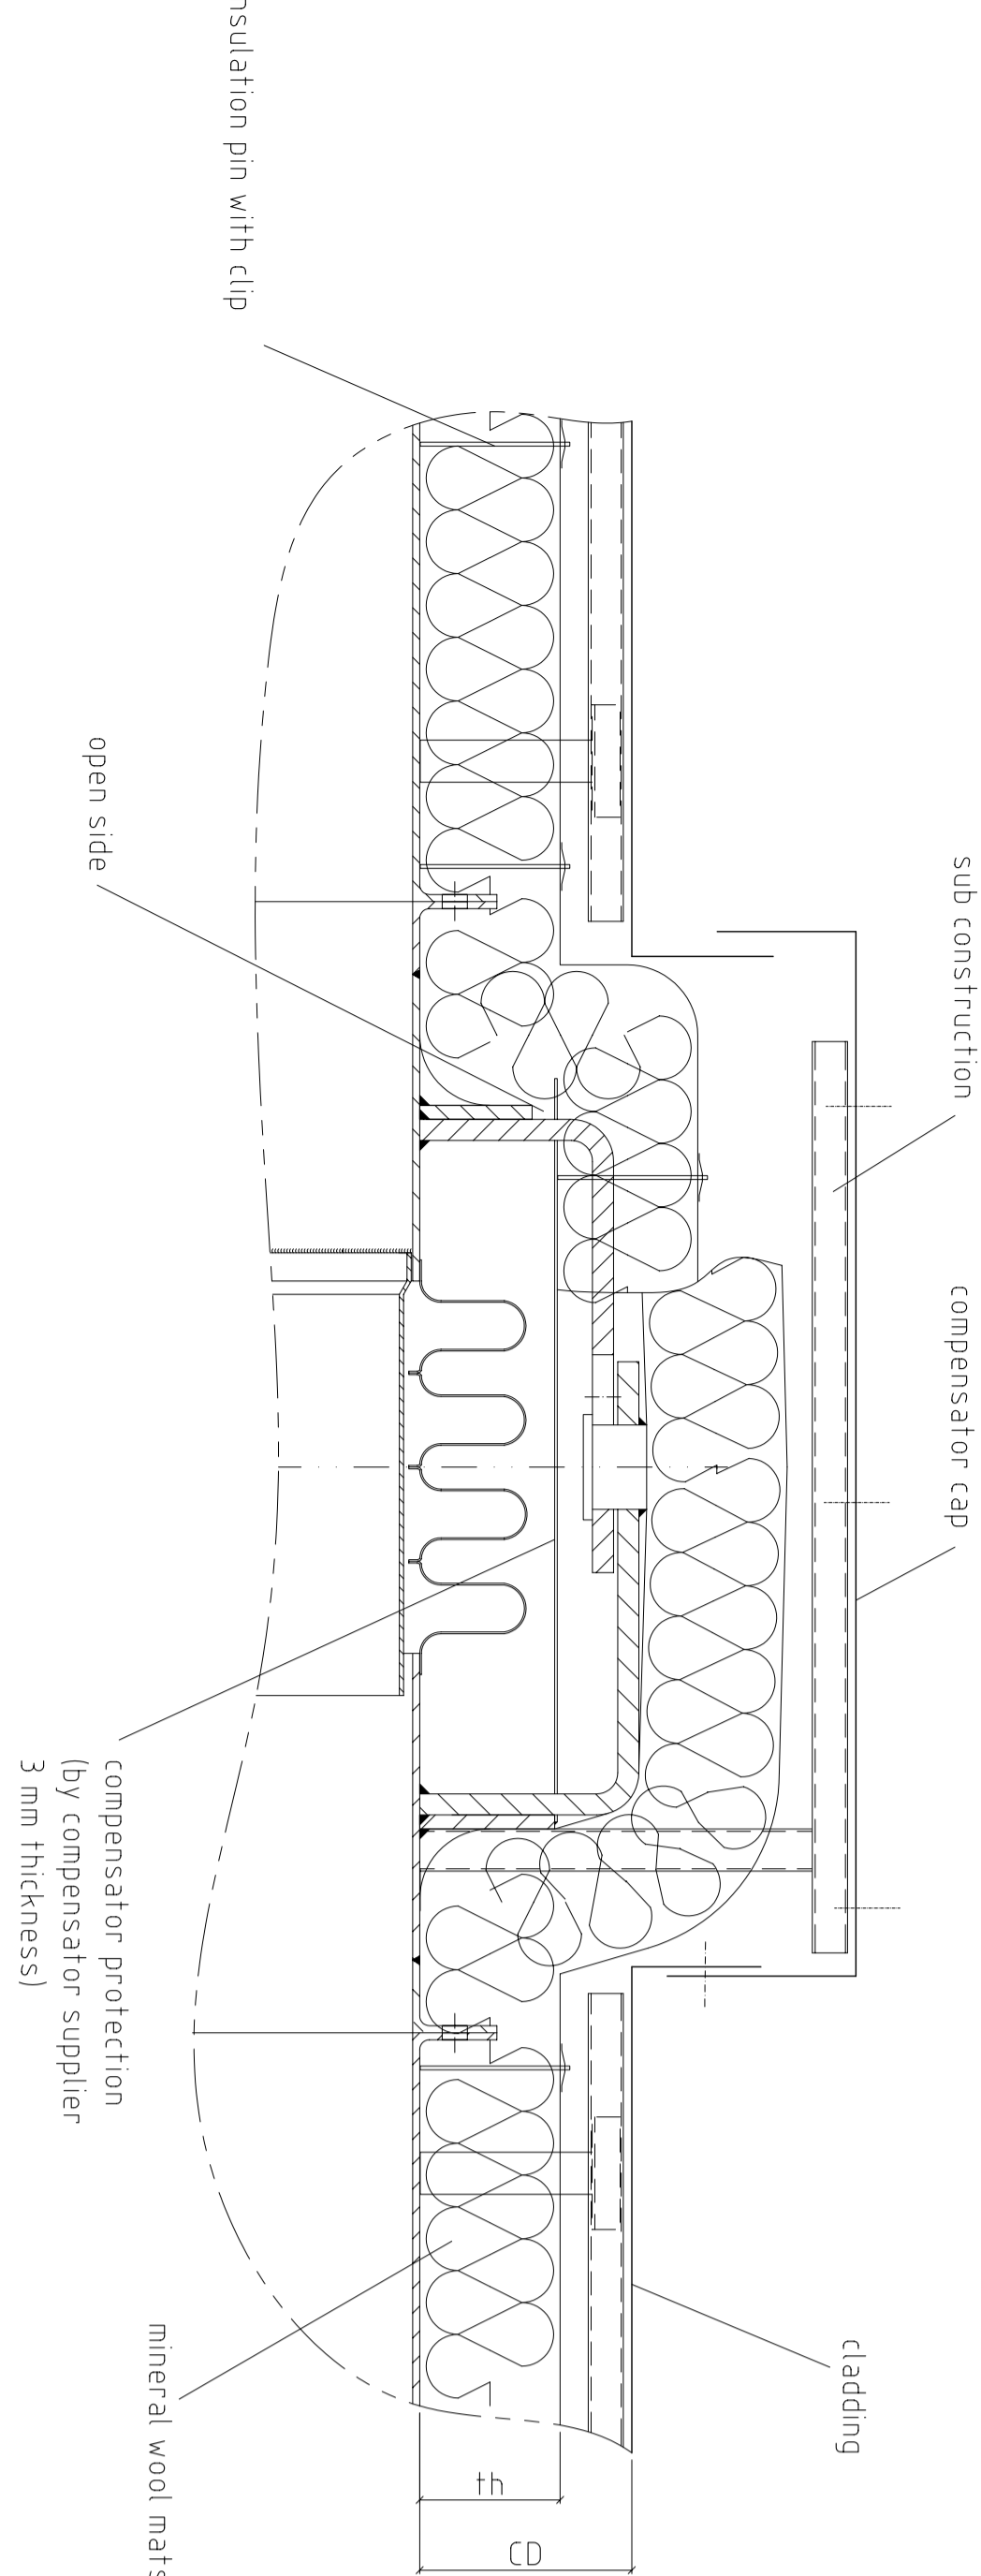

Detail:
Manhole indoor
with internal insulation

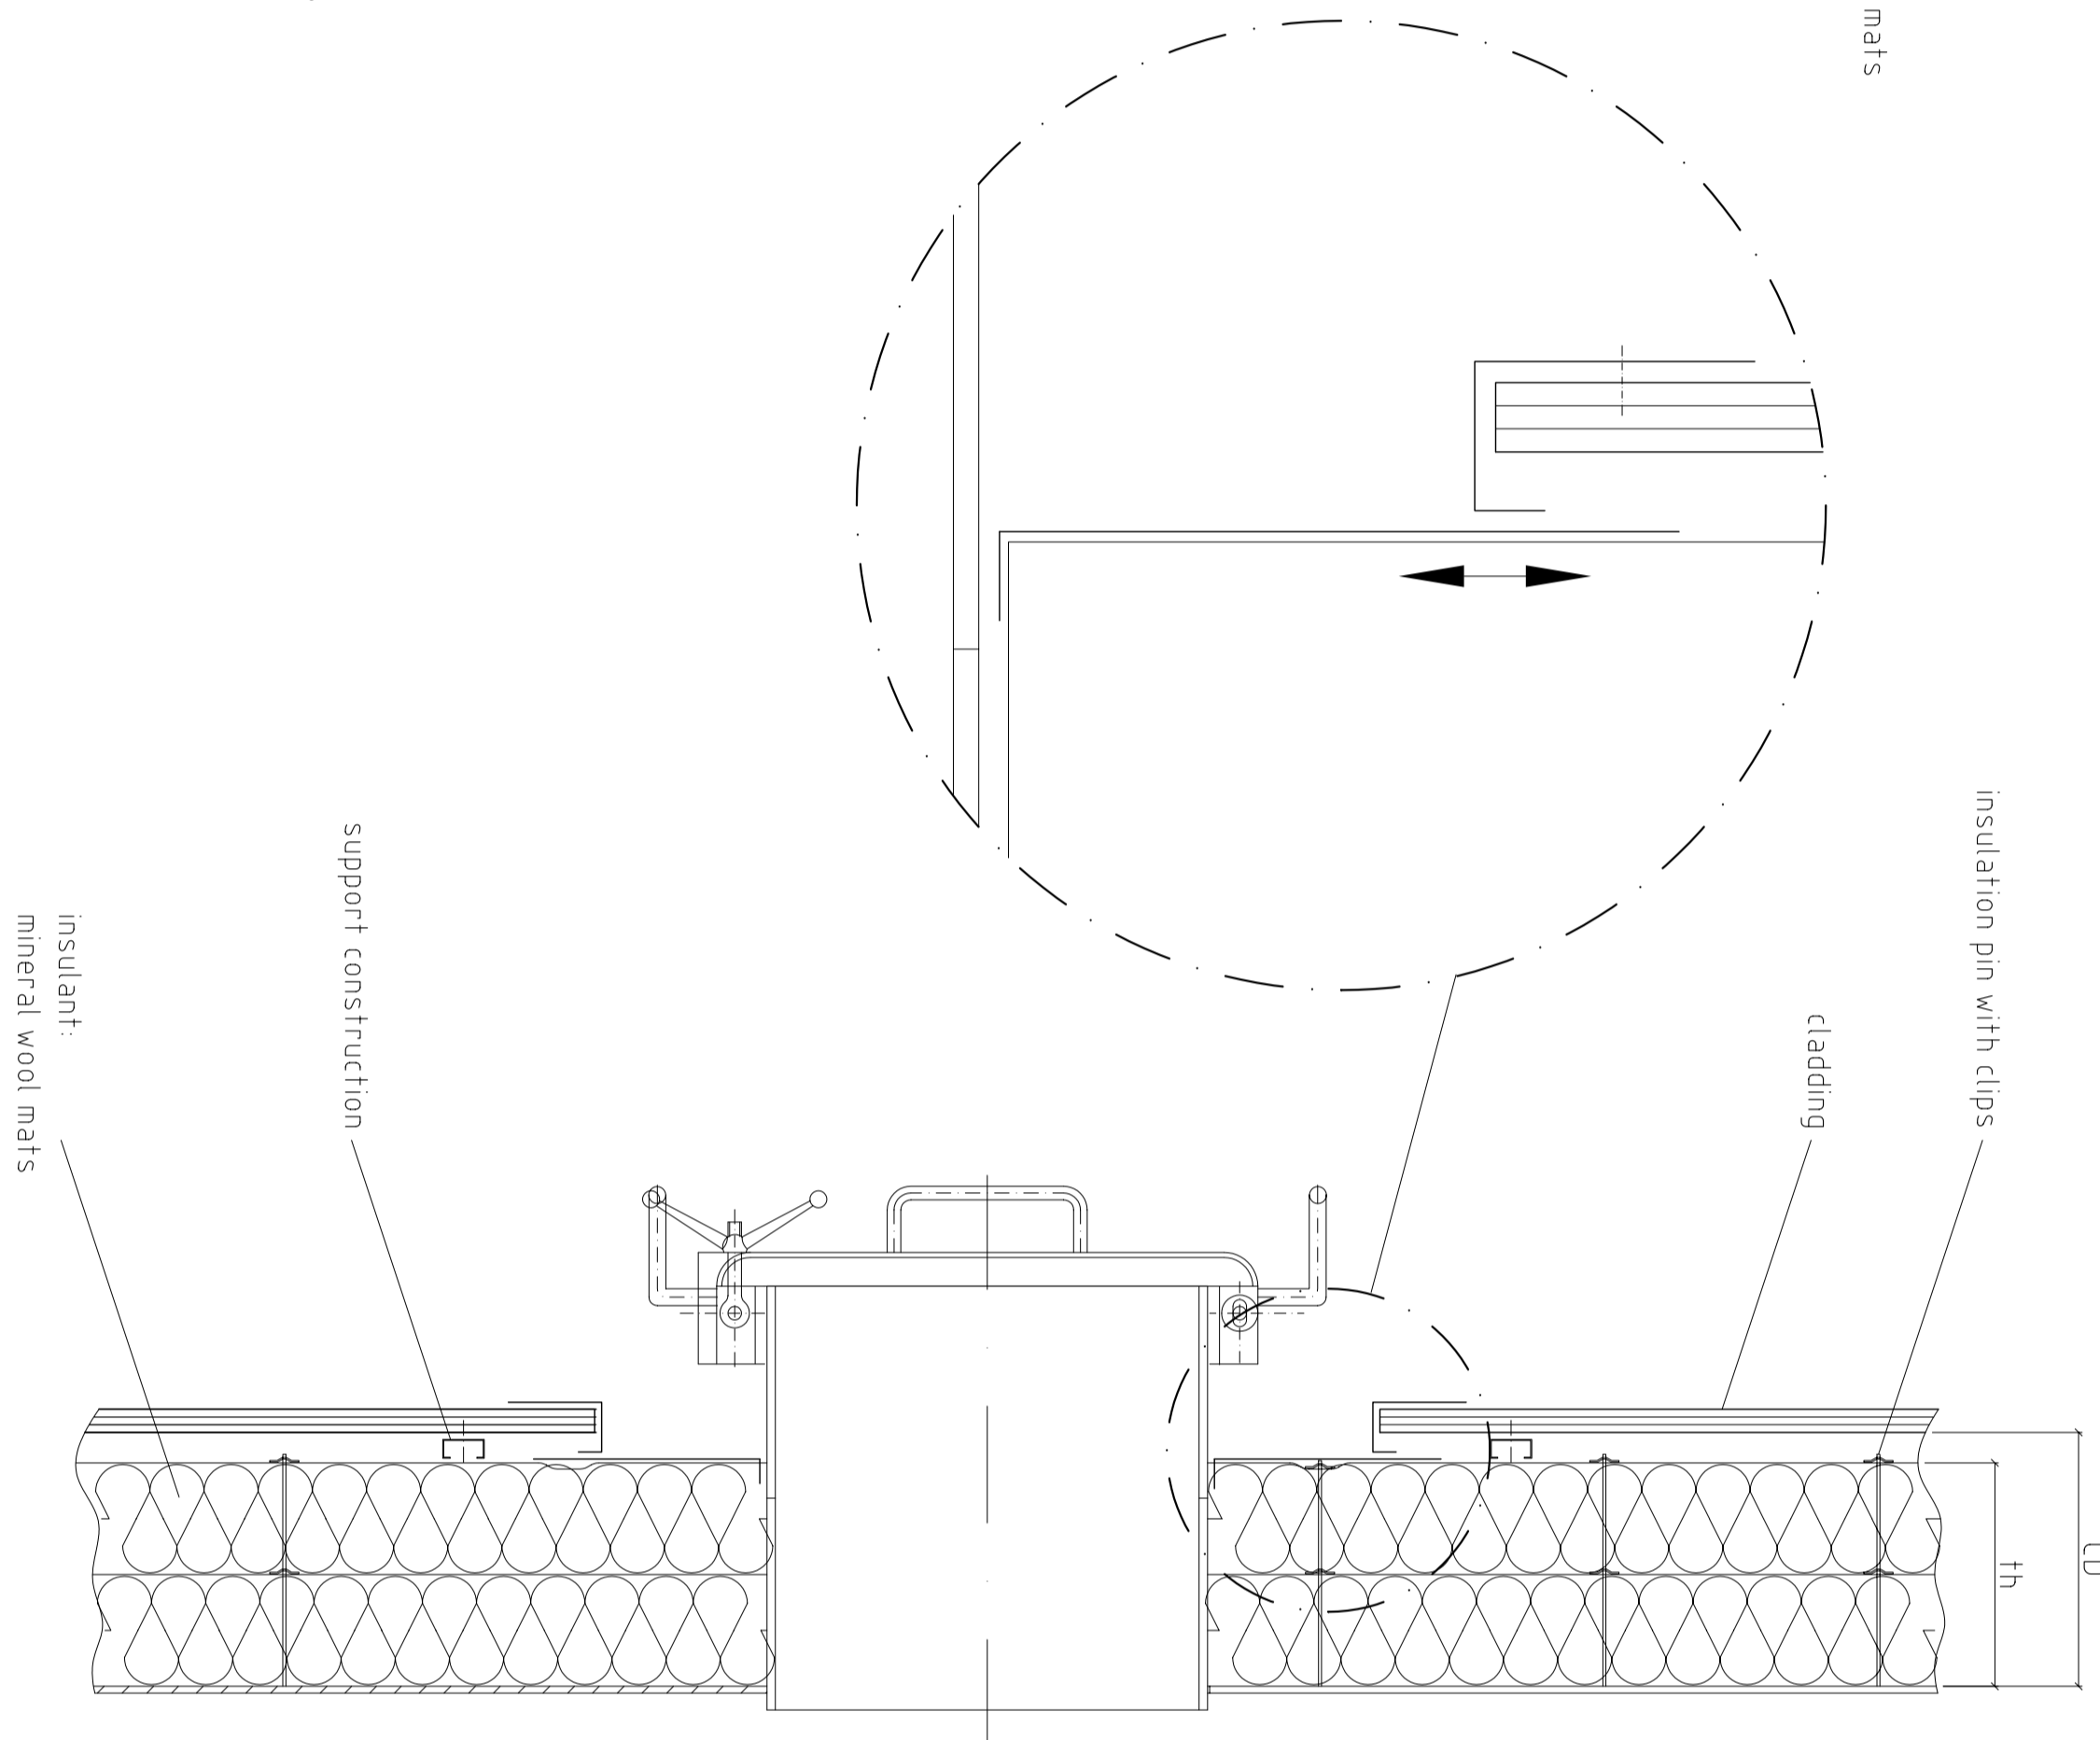

Detail:
Manhole Outdoor
with internal insulation

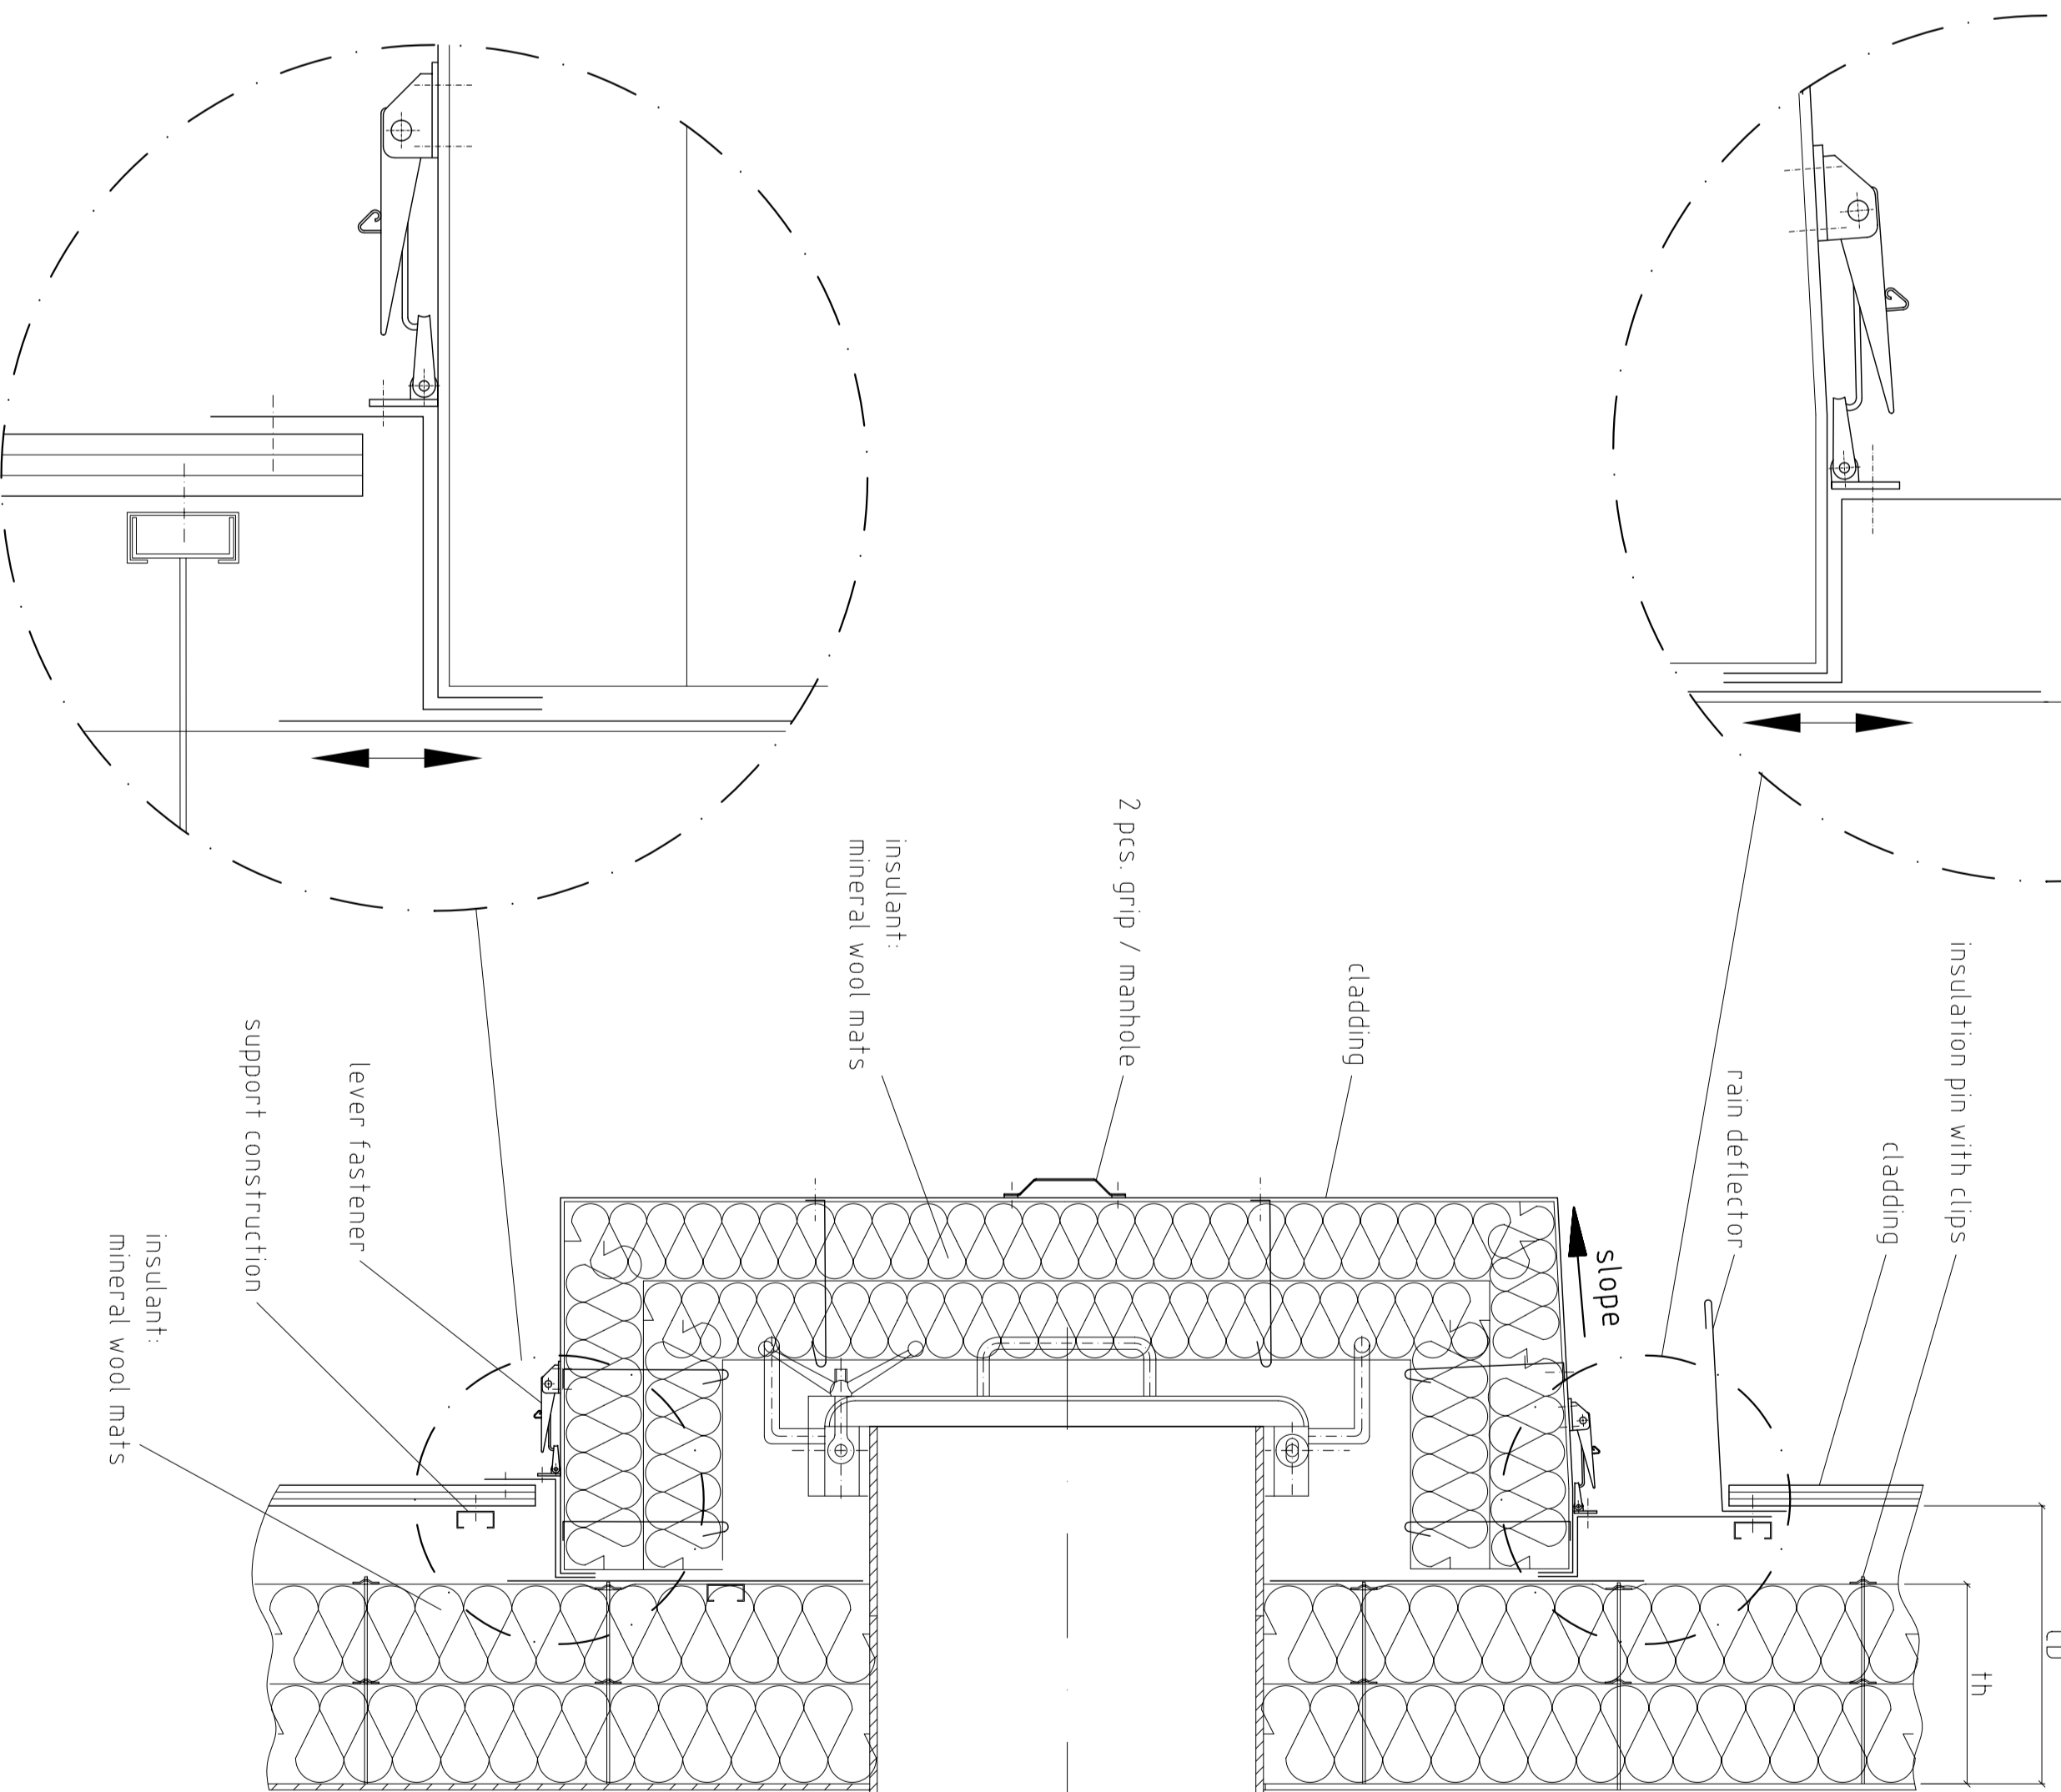

Legend
(P) = PARTITIONING
(P) = FIX POINT
(9) = SLIDING POINT
(SS) = SLIDING SEAM
th = INSULATION THICKNESS
(D) = LANDING DISTANCE

Rev.	Revision Date	Created By	Approved By	Description	Status
1	17.11.09	BPUR	AMAP	SUPPLIER CHANGED TO G&H/OKI	
0	14.08.09	PVP	IC	FIRST ISSUE	
Project (Project)					
Moritza East I Power Station					
TEL Mopua Namok 1					



Rev.	Revision Date	Created By	Approved By	Description	Status
1	17.11.09	BPUR	AMAP	SUPPLIER CHANGED TO G&H/OKI	
0	14.08.09	PVP	IC	FIRST ISSUE	
Project (Project)					
Moritza East I Power Station					
TEL Mopua Namok 1					

Rev.	Revision Date	Created By	Approved By	Description	Status
1	17.11.09	BPUR	AMAP	SUPPLIER CHANGED TO G&H/OKI	
0	14.08.09	PVP	IC	FIRST ISSUE	
Project (Project)					
Moritza East I Power Station					
TEL Mopua Namok 1					